


6 Dimensional drawings

6 - 1 Dimensional Drawings

BS1Q10A

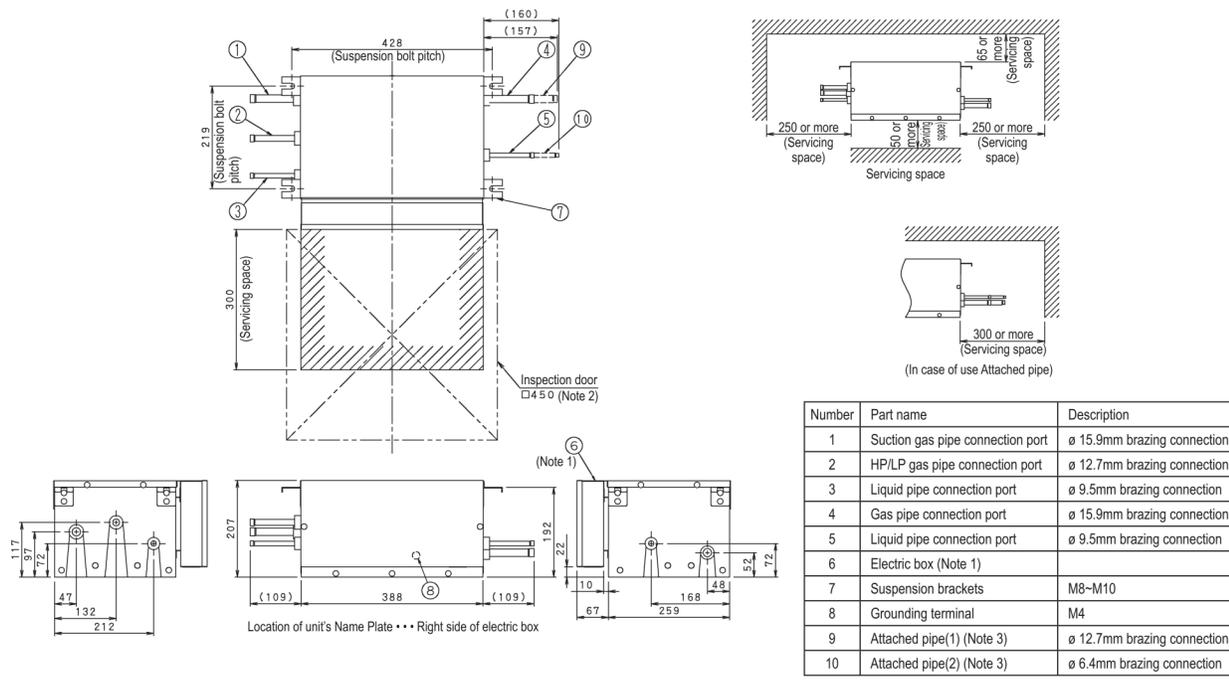


NOTES

1. Electric box can also be fixed on the other side of the unit.
2. Be sure to install an inspection door at electric box side.
3. Attached pipe is only used in case of connecting with a 20-50 class indoor unit.
4. Small sound of refrigerant will be made, which may be disturbing.
Do not install it at the place such as bedroom under roof.

3D056011B

BS1Q16A

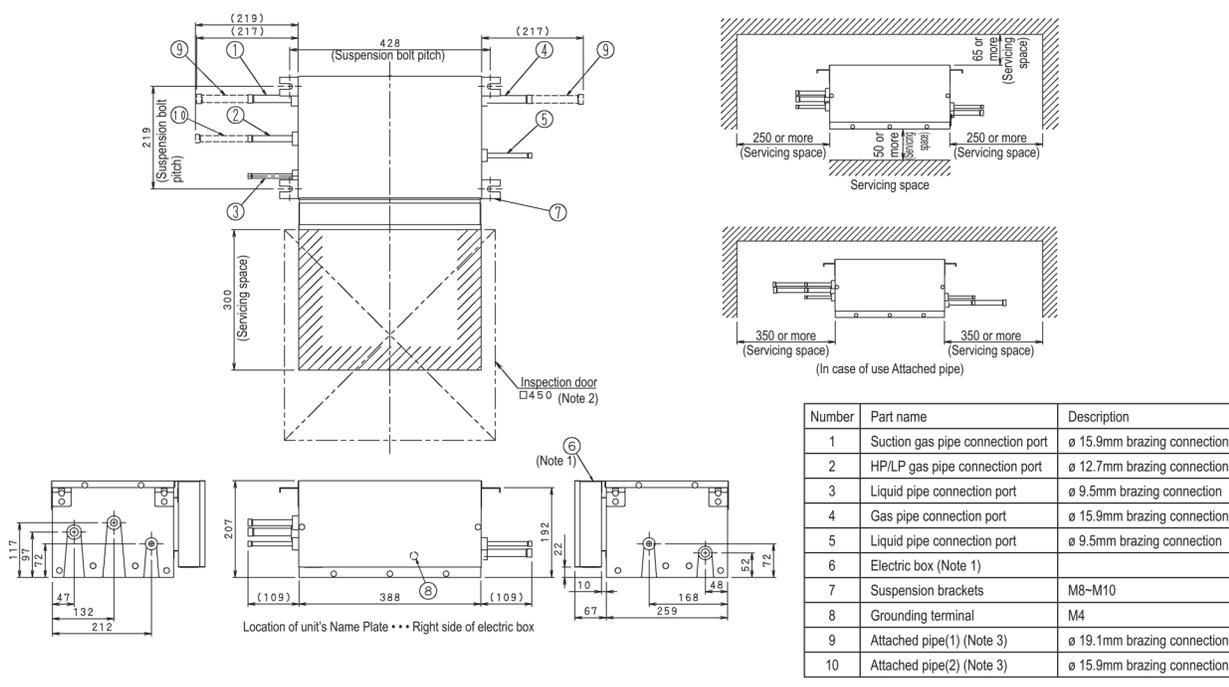

NOTES

1. Electric box can also be fixed on the other side of the unit.
2. Be sure to install an inspection door at electric box side.
3. Attached pipe is only used in case of connecting with indoor unit capacity index 150 or more and 160 or less.
4. Small sound of refrigerant will be made, which may be disturbing.
Do not install it at the place such as bedroom under roof.

3D058004B