

6 Dimensional drawings

6 - 1 Dimensional Drawings

FXKA20-32A FXKQ20-32A

Notes



1. Location of nameplate
The unit nameplate is located on the control box cover.
The decoration panel nameplate is located on the inner frame inside the suction grille.
2. Though the installation is acceptable up to maximum 910x510-mm square ceiling opening, keep the clearance of 35-mm or less between the indoor unit and the ceiling opening, so that the panel overlap allowance can be ensured.
3. When installing optional accessories, refer to their respective documentation.
4. If any of the following conditions are met, additional insulation (glass wool or polyethylene foam, thickness ≥ 10-mm) is required:
Ambient conditions in the ceiling ≥ 30°C and 80% relative humidity.

Fresh air is inducted into the ceiling.
The unit operates continuously.




Model	øA	øB
FXKQ20AMVEB	6.4	12.7
FXKQ25AMVEB	6.4	12.7
FXKQ32AMVEB	6.4	12.7
FXKQ40AMVEB	6.4	9.5
FXKQ50AMVEB	6.4	9.5
FXKQ63AMVEB	6.4	9.5
FXKQ80AMVEB	6.4	9.5

Item	Part name
①	Liquid pipe connection -øA-
②	Gas pipe connection -øB-
③	Drain outlet Inside diameter: 20 mm Outside diameter: 25 mm
④	Power supply wiring intake
⑤	Wiring connection Remote control wiring intake

Item	Part name
⑥	Air discharge side
⑦	Air suction side
⑧	Drain hose (accessory) Inside diameter: 25 mm
⑨	Metal hanger

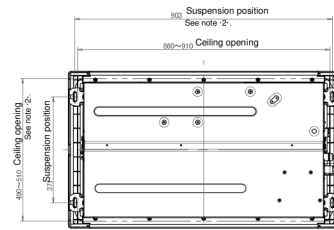

Required space

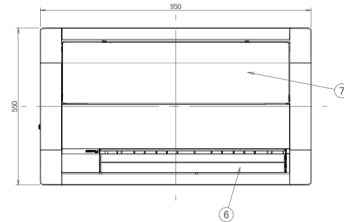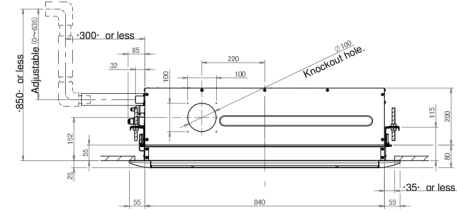

Adjusting the air flow direction

Up/down (automatic)

Left/right (automatic)

Air discharge range Swing

2D146914A

FXKA40-63A FXKQ40-63A

Notes



1. Location of nameplate
The unit nameplate is located on the control box cover.
The decoration panel nameplate is located on the inner frame inside the suction grille.
2. Though the installation is acceptable up to maximum 1310x510-mm square ceiling opening, keep the clearance of 35-mm or less between the indoor unit and the ceiling opening, so that the panel overlap allowance can be ensured.
3. When installing optional accessories, refer to their respective documentation.
4. If any of the following conditions are met, additional insulation (glass wool or polyethylene foam, thickness ≥ 10-mm) is required:
Ambient conditions in the ceiling ≥ 30°C and 80% relative humidity.

Fresh air is inducted into the ceiling.
The unit operates continuously.




Model	øA	øB
FXKQ40AMVEB	6.4	12.7
FXKQ50AMVEB	6.4	12.7
FXKQ63AMVEB	9.5	15.9
FXKA40AMVEB	6.4	12.7
FXKA50AMVEB	6.4	12.7
FXKA63AMVEB	6.4	12.7

Item	Part name
①	Liquid pipe connection -øA-
②	Gas pipe connection -øB-
③	Drain outlet Inside diameter: 20 mm Outside diameter: 25 mm
④	Power supply wiring intake
⑤	Wiring connection Remote control wiring intake

Item	Part name
⑥	Air discharge side
⑦	Air suction side
⑧	Drain hose (accessory) Inside diameter: 25 mm
⑨	Metal hanger

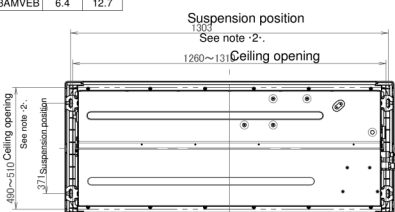

Required space

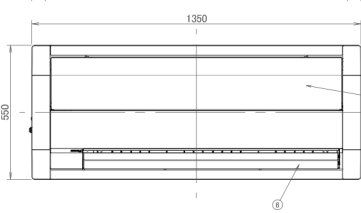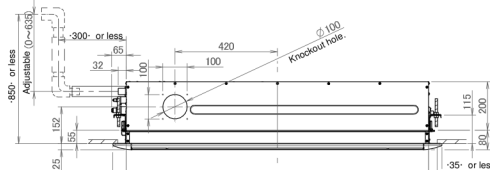

Adjusting the air flow direction

Up/down (automatic)

Left/right (automatic)

Air discharge range Swing

2D148806A