


5 Dimensional drawings

5 - 1 Dimensional Drawings

VAM1500-2000J8

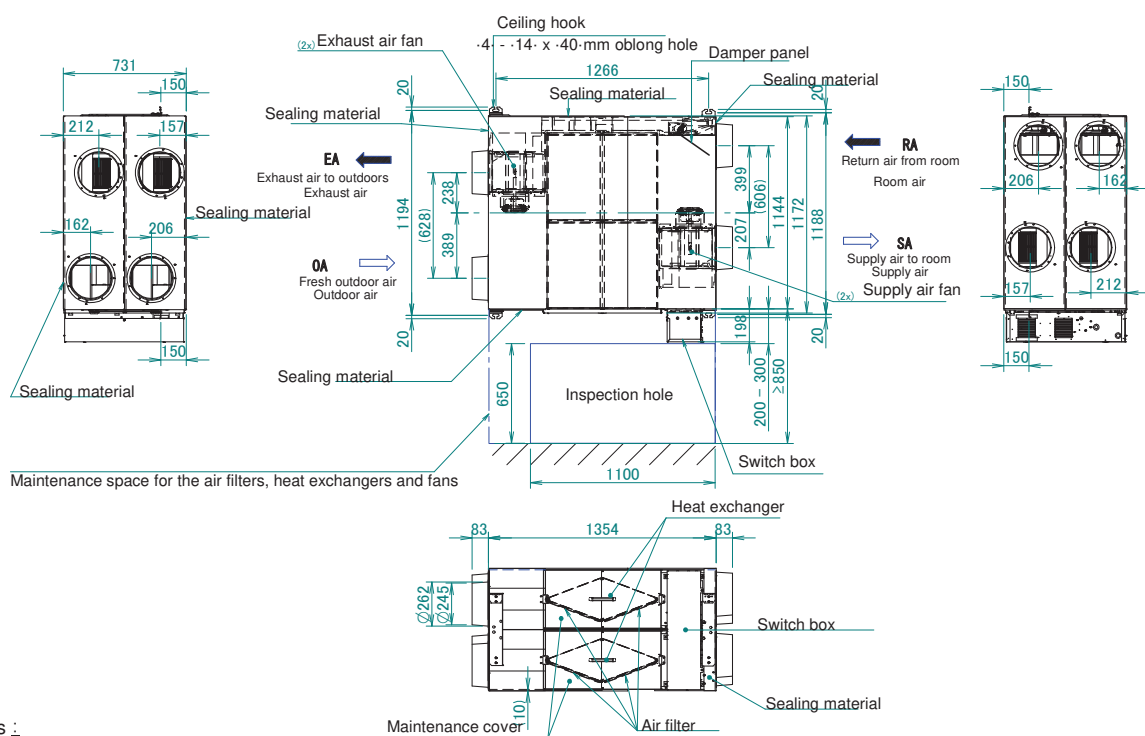


Notes :

1. To perform maintenance on the air filter, it is required to provide a service access panel.

3D112828C

VAM1500-2000J8

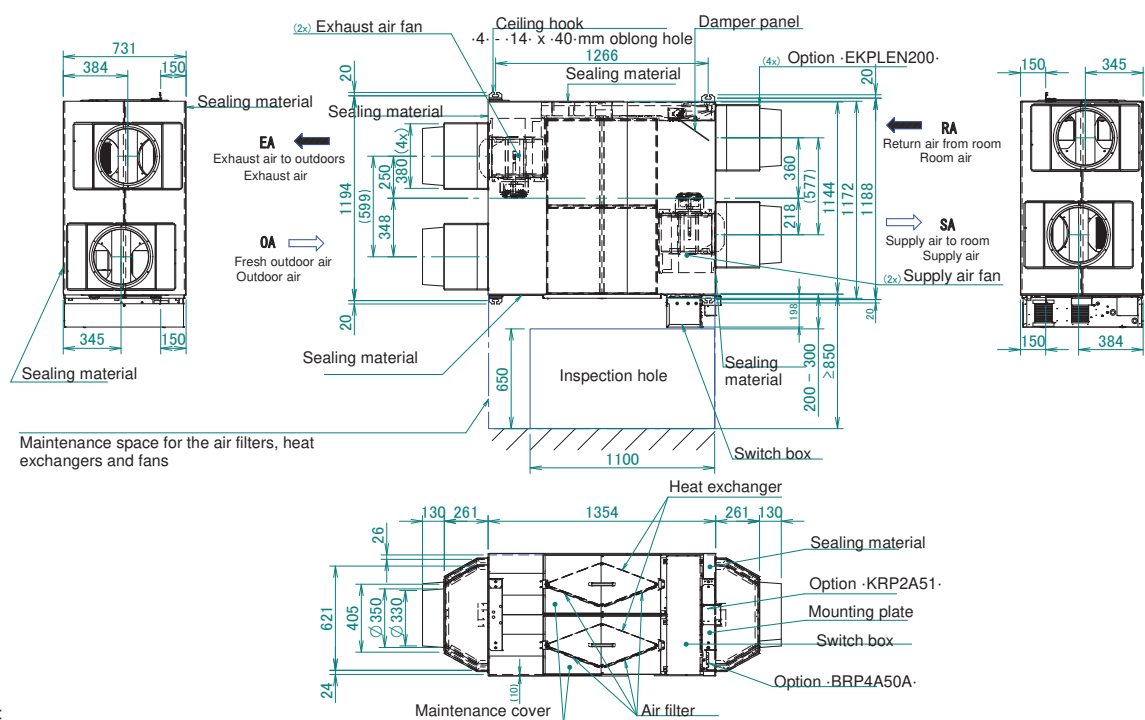

Notes :

1. To allow for the inspection of the air filters, heat exchangers, and fans, be sure to provide the inspection hole.

3D112818C